

# We are IntechOpen, the world's leading publisher of Open Access books Built by scientists, for scientists

6,900

Open access books available

185,000

International authors and editors

200M

Downloads

Our authors are among the

154

Countries delivered to

TOP 1%

most cited scientists

12.2%

Contributors from top 500 universities



WEB OF SCIENCE™

Selection of our books indexed in the Book Citation Index  
in Web of Science™ Core Collection (BKCI)

Interested in publishing with us?  
Contact [book.department@intechopen.com](mailto:book.department@intechopen.com)

Numbers displayed above are based on latest data collected.  
For more information visit [www.intechopen.com](http://www.intechopen.com)



---

# Kalman Filters for Reference Current Generation in Shunt Active Power Filter (APF)

---

Ahmad Shukri Bin Abu Hasim,  
Syed Mohd Fairuz Bin Syed Mohd Dardin and  
Zulkifilie Bin Ibrahim

Additional information is available at the end of the chapter

<http://dx.doi.org/10.5772/intechopen.72467>

---

## Abstract

Shunt active power filter (APF) method have been used by many researchers as a solution in reducing the harmonics creating by the non-linear loads. Therefore, this research is targeted to design and implement a three-phase shunt APF employing Kalman filter estimator. Conventionally, low-pass filter (LPF) is used to filter out the unwanted DC component of the non-linear load to produce the sinusoidal waveform called the reference current. However, when applying LPF it contributes with the phase shift and high transient at the supply current. Therefore, to reduce these problems, the digital Kalman filter estimator is used to replace the LPF for generating the reference current. Details on the investigation between conventional and proposed methods under simulation based on Matlab Simulink platform and experimental that are made for two types of load, namely, three-phase rectifier with RC-load and three-phase induction motor, are presented. The performance criteria of the shunt APF are determined by the supply current waveform, total harmonic distortion (THD), harmonic spectrum and power quality measurements, which were also obtained by simulation and experimental. In conclusion, by employing Kalman filter estimator for generating the reference current, it reduces the time delay and high transient current at the power supply and, thus, improved the overall THD from 0.1 to 0.42% compared to the LPF.

**Keywords:** three-phase system, harmonic reduction, active power filter (APF), reference current generation, Kalman filter

---

## 1. Introduction

Electrical power is essential to people's modern lifestyle. In recent five decades, due to the development of the industry contributed to the increase of the types and capacity of the

grid connected load drastically. For that reason, all the electrical consumers at all levels of usage have facing an issue of power quality problems. Both industrial/commercial sector and domestic environment commonly use sensitive equipment and non-linear loads (NLL). Inadvertently, these result in a non-sinusoidal current being drawn from the supply, which contains the harmful harmonic component and fed back to the supply system on the same point of common coupling (PCC). Passive filter is one of the common methods that have been used to overcome this problem. The passive filter is connected in parallel between the supply and NLL for improvement of power factor and harmonic suppression and thus exhibits lower impedance at tuned harmonic frequency. However, this approach does not solve the problem effectively due to its inability to compensate random frequency variation in the current, tuning problem and parallel resonant. Among the techniques, the  $d-q$  algorithm has been widely used to eliminate the harmonics due to its simplicity of control design relative to the rest. Commonly, the  $d-q$  algorithm is using LPF to generate the reference current. However, time delay introduced when applying the LPF will contribute to the phase shift in harmonics and higher transient current. Therefore, a new proposed technique of the current reference generator embedded with Kalman filter for shunt APF system is proposed where it reduces the time delay, thus producing improvement of the overall total harmonic distortion (THD) in the system.

### 1.1. State of the art

The active power filter (APF) technology is now mature in providing compensation for harmonics, reactive power and neutral current in AC networks. It has evolved for the past quarter century of development with varying configurations, control strategies and solid-state devices. Commonly, the APFs are used to eliminate the voltage harmonics, regulate terminal voltage, suppress voltage flicker and improve voltage balance in three-phase systems. This wide range of objectives can be achieved either individually or in combination depending upon the requirements, control strategy and configuration, which have to be selected appropriately. This section describes the history of development and the present status of the APF technology.

With the proliferation of power electronics in energy conversions, power quality is fast becoming an issue of an increasingly important aspect of electrical consumers at all levels of usage. A large number of publications have been covering the power quality survey, measurements, analysis, cause and effects of harmonics and reactive power in the electric networks [1–9]. APFs can be categorized into three types, namely, two-wire (single-phase), three-wire and four-wire three-phase configurations, to meet the requirements of the three types of NLL on supply systems. Domestic lights and ovens, TVs, computer power supplies, air conditioners, laser printers and Xerox machines behave as NLL and cause power quality problems for single-phase loads. For this type of load, the APFs are investigated in varying configurations and control strategies [10–19]. Starting in 1971, many configurations of APF have been developed for improving the power system quality. It can be categorized into four basic types, namely, series, parallel (shunt), hybrid APFs and unified power quality conditioner (universal AF). The series APF operates mainly as a voltage regulator and a harmonic isolator between NLL and utility system [20–23]. In other

words, it allows only fundamental component of the current to flow in the system, suppressing other higher-frequency components. It can also be used to regulate the negative sequence voltage at the load. The series active filter is ideal for eliminating and/or maintaining the output voltage while balancing three-phase voltages [20, 21, 23–26]. On the other hand, shunt APF has been widely used to mitigate the harmonics. It cancels the load-current harmonics and provides reactive compensation to the supply, through the act of injecting equal but opposite harmonic compensating current to the supply [27–38]. Shunt APF has the advantage of carrying only the compensation current plus a small amount of active fundamental current to compensate for system losses. It is also possible to connect several filters in parallel to cater for higher currents, making this type of circuit suitable for a wide range of power ratings [26, 39, 40]. The most common configuration of shunt APF is the inverter type where the role of the filter inductor is to suppress the high frequency at tuned current generated at tuned frequency, while the converter provides complementary filtering on others that includes any random variations through switching techniques [28, 34, 41, 42]. The shunt APF controller can be used in direct or indirect connection. Hybrid APF can be characterized by a combination of passive filter and APF in series or parallel. The combination between series APF with parallel passive filter is the most popular arrangement because the solid-state devices used in active series part help in reducing the size and cost, to about 60–80% of load size [43, 44]. Furthermore, the passive parallel LC filter is used to eliminate lower-order harmonics at reasonable cost [26, 37, 44–49]. Another arrangement is the combination of active filter in series with a parallel passive filter, which is used especially for medium- and high-voltage applications [26]. Further arrangements also include a combination of parallel active and passive filters where the APF part is designed to eliminate the lower order of harmonics, while the passive filter works to eliminate the bulk load-current harmonic [26]. The combination of series active and parallel APF will produce unified power quality conditioner (also known as universal AF). The DC-link element of either inductor or capacitor is shared between two current sources or voltage-source bridges operating as active series and active parallel compensator [50, 51]. This universal AF is considered as an ideal AF, which eliminates voltage and current harmonics, thus capable of providing clean power to critical and harmonic-prone loads, such as computer, medical equipment and others. The main drawbacks are large costs and complex control due to dependency on the number of solid-state devices involved [26, 50, 51].

Many control approaches have been developed to extract and estimate the harmonics in the system. Instantaneous reactive power theory ( $p-q$  theory), modified  $p-q$  theory [52–54],  $p-q-r$  theory [55, 56], vectorial theory [57] and  $d-q$  theory [58–60] are the techniques that fall into the extraction technique. Due to its simplicity of control design relative to the rest, for that reason this  $d-q$  algorithm has been widely used to eliminate the harmonics [61]. On the other hand, estimation approach is used to estimate harmonics of frequency component present in the signal and measurement or estimation of the amplitude and phases of those frequencies [62]. This approach can be divided into two classes, non-parametric and parametric methods. The non-parametric methods are based on transformation of the given time-series data sequence. During the estimation process, these methods are not capable of incorporating with any available information about the system. Frequency domain approach using Fourier transform is most commonly used for spectrum analysis in this harmonic estimation [62]. In addition, parametric methods use an appropriate model to represent the signal and then estimate the

parameters of the model from the available data points. Estimated parameters are applied to the selected model to determine harmonic contents in the signal. This parametric methods offer higher resolution and better accuracy than the non-parametric methods [62]. Kalman filter (KF) estimator is one of the methods that fall into the parametric method category which have been widely studied and used for different applications [62–69].

### 1.2. Main contribution

There are three main contributions regarding with this research:

- a. Developed a new design of shunt APF employing Kalman filter estimator.
  - The new design of shunt APF for generating the reference currents using Kalman filter estimator was proposed to reduce the delay time and high transient current when applying the conventional technique. In addition, the developed system was tested for two different types of loads such as three-phase rectifier with RC-load and three-phase induction motor.
- b. Investigation of the details of performance based on simulation and experimental for conventional and the proposed technique.
  - The investigation criteria are on the harmonic spectrum, THD and power quality for different three types of load because these criteria affect directly the performance of system that used active power filter.
- c. Comparative studies between the conventional and the proposed technique upon experimental implementation.
- d. An analysis is carried out in terms of harmonic spectrum, THD and power quality as well to validate the advantages offered by employing the new techniques relative to the common implementation of an active power filter.

### 1.3. Proposal of the research

Power quality problems have becoming a critical issue when dealing with power electronic converter and NLL due to the effects of the harmonic contamination in power system. Many techniques have been proposed to overcome these problems such as passive filter which contribute to improve the power factor and harmonic suppression and exhibit lower impedance at a tuned harmonic frequency. However this approach provides incomplete solutions particularly when compensating random frequency variations in the current, tuning and parallel resonant problems. Therefore, various active power filter (APF) configurations with their respective control strategies have been proposed and have been recognized as a viable solution to the problem created by harmonics. Among the technique, the  $d$ - $q$  algorithm has been widely used to eliminate the harmonics due to its simplicity of control design relative to the rest. Commonly, the  $d$ - $q$  algorithm is using LPF to generate the reference current. However, time delay introduced when applying the LPF will contribute to the phase shift in harmonics and higher transient current. A new proposed technique of the current reference generator embedded with Kalman filter (KF) for shunt APF system is proposed as shown in **Figure 1**. The KF in the system was used as a LPF to produce a reference current in three-phase system



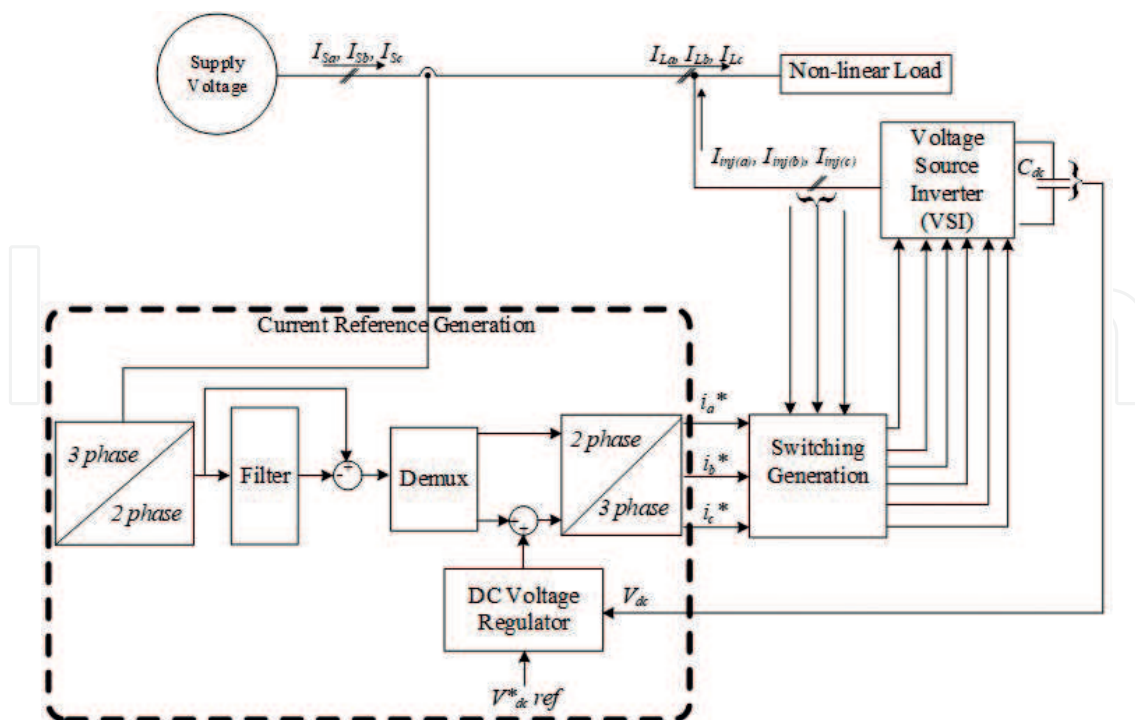


Figure 1. Overall system of shunt APF.

as shown in **Figure 2**. The KF used a form of feedback control in which the filter estimates the process at any time and then obtains feedback in the form of noisy measurements. These noisy measurements can be further exploited to improve the next estimates in which KF is able to perform because it has both time update and measurement update equations. The time update also known as predictor equation is responsible for projecting forward (in time) current state and error covariance estimate to obtain the estimation in the next time step, while the measurement update equation also called corrector equation is responsible for the feedback such as for incorporating a new measurement into the estimator to improve the

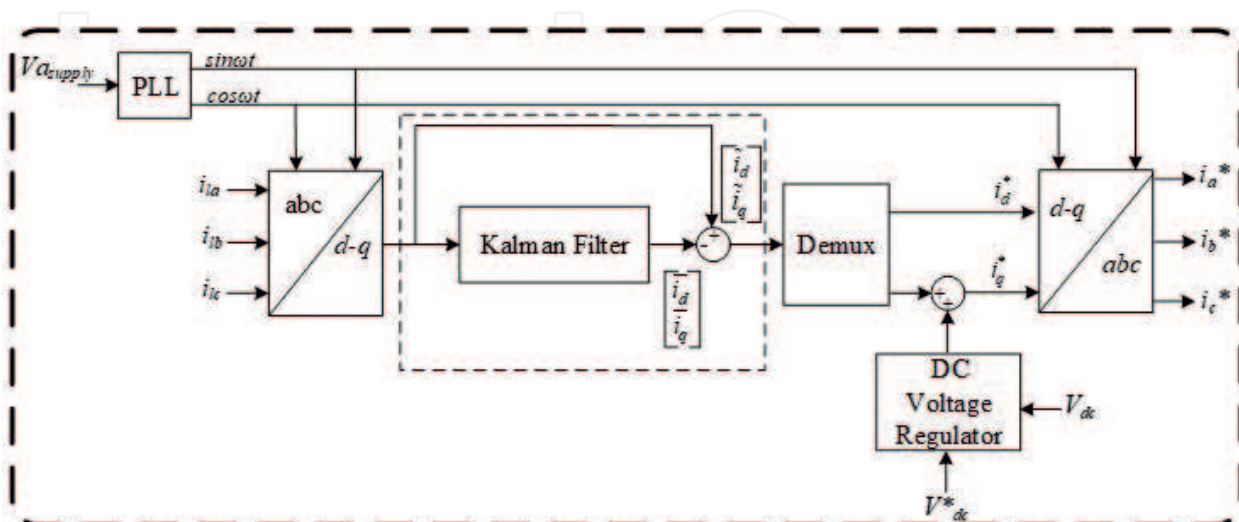


Figure 2. New technique of three-phase reference current generator employing Kalman filter estimator.

estimation. Therefore the estimation resembles the combination of predictor-corrector algorithm, which is used in the system. By applying KF, it improves the overall performance and also reduces the time delay and transient current which occurs in the conventional technique. Furthermore, this technique uses every measurement that the system has to further improve on the results by giving a better estimate at each time epoch. The significant improvement can be observed at the total harmonic distortion (THD) reduction at 2.38% compared to when the shunt APF is not implemented at all which performs at 168.39%. The TDH of the source current after the compensation is at 2.18% which is way below the IEEE 519 Standard which imposed a limit at less than 5% of the overall harmonics. In fact, for comparison, the use of KF also performed better than the established low-pass filter, which performs at 2.8% of the THD.

## 2. Mathematical formulation

There are three elements that involved in generating the required current reference that is used to compensate the undesirable load current components as shown in **Figure 2**. These elements are stationary reference frame, Kalman filter (KF) and DC voltage regulator. The mathematical formulation for each element is further explained in the next subtopics.

### 2.1. Stationary reference frame

Stationary reference frame also known as  $d$ - $q$  algorithm was developed based on Park transformation. This method transforms three-phase into  $d$ - $q$  coordinates (rotating reference frame with fundamental frequency) using Park transformations. In this case, the load currents are measured and transformed into  $d$ - $q$  coordinates. The equations to transform  $a$ - $b$ - $c$  coordinate into  $\alpha$ - $\beta$ - $0$  coordinate is presented in Eq. (1):

$$\begin{bmatrix} i_o \\ i_\alpha \\ i_\beta \end{bmatrix} = \sqrt{\frac{2}{3}} \begin{bmatrix} 1/\sqrt{2} & 1/\sqrt{2} & 1/\sqrt{2} \\ 1 & -1/2 & -1/2 \\ 0 & \sqrt{3}/2 & -\sqrt{3}/2 \end{bmatrix} \begin{bmatrix} i_{La} \\ i_{Lb} \\ i_{Lc} \end{bmatrix} \quad (1)$$

By employing Park transformation, the  $\alpha$ - $\beta$ - $0$  coordinate is transformed into  $d$ - $q$  coordinate as shown in Eq. (1):

$$\begin{bmatrix} i_d \\ i_q \end{bmatrix} = \begin{bmatrix} \cos\theta & \sin\theta \\ -\sin\theta & \cos\theta \end{bmatrix} \begin{bmatrix} i_\alpha \\ i_\beta \end{bmatrix} \quad (2)$$

where  $\theta = \tan^{-1}\left(\frac{i_\beta}{i_\alpha}\right)$ .

The phase angle,  $\theta$ , in  $d$ - $q$  frame is the same with fundamental frequency which makes the DC fundamental current component ( $i_d$ ,  $i_q$ ) and harmonic AC component ( $i_{d'}$ ,  $i_{q'}$ ) arise due to harmonics at the load [61]. Low-pass filter (LPF) is normally used to determine the DC component. Nevertheless, for such system, phase shift in harmonics and high transient response is unavoidable before attaining its steady state. This is where KF estimator is used to replace the LPF and further improve the overall performance of the system. In order to stabilize the voltage on the DC side of the VSI, the measurement voltage,  $V_{dc}$ , measure must follow the reference voltage,  $V_{dc \text{ ref}}$ . Therefore, DC voltage regulator loop is designed by integrating a suitable PI controller.

## 2.2. DC voltage regulator

The DC voltage regulator is controlled with a traditional PI controller. The DC voltage,  $V_{dc}$  is measured and then compared with a constant reference value  $V_{dc}^*$ . The error is processed by a PI controller with two gains:  $K_p$  and  $K_i$ . Both gains are calculated and tuned accordingly to the dynamic response in which the values of both gain are set to 4 for  $K_p$  and 91 for  $K_i$ .

## 2.3. Kalman filter

The use of Kalman filter (KF) provides an efficient computational means to estimate the state of a process which is able to minimize the means of the squared error. This is achieved by keeping tracks of the estimated state of the system as well as the variance of the estimates via two distinct phases: predict and update. The basic KF can be defined as.

$$x_k = A x_{k-1} + B u_k + w_k \quad (3)$$


and

$$z_k = H x_k + v_k \quad (4)$$

where  $A$  is the state transition matrix,  $B$  is the control matrix that is applied to  $u_k$ , which is the control vector of the system, and  $H$  is defined as observation matrix with  $x_k$  the state of the system and  $y_k$  the measurement or sometimes called observation vector.  $w_k$  and  $v_k$  are the process noise vector and observation noise vector, respectively, and it is assumed to be mutually independent and normally distributed. Relative to the system, since the fundamental positive sequence components of the non-linear load current appears as DC quantities of the synchronous reference frame rotating at 50 Hz, it can then be separated from the load currents using KF as depicted in **Figure 3**.

In this case, the state transition matrix is the differential equation that relates the state at the previous time step  $k - 1$  to the current step  $k$ . Therefore, the state vector  $x_k$  can be further defined as.

$$x_k = \begin{bmatrix} i_{d(k)} \\ i_{q(k)} \end{bmatrix} \quad (5)$$

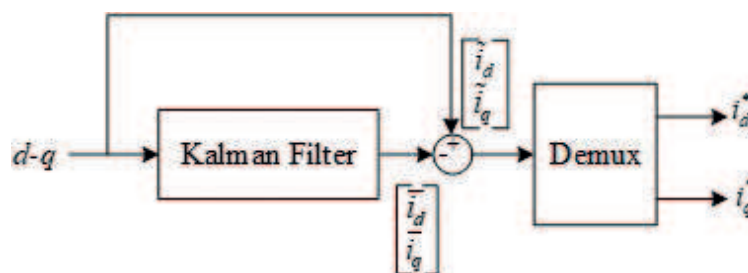

**Figure 3.** Kalman filter.



Furthermore, the optional control input which defined the control matrix  $B$  can be neglected. Since the system only measured two parameters, respectively, therefore the measurement matrix can be simply represented by two-by-two identity matrix. Therefore, the implementation of the KF can be rewritten as.

$$\begin{aligned} x_k &= A x_{k-1} + w_k \\ P_k^- &= A P_{k-1} A^T + Q \end{aligned} \quad (6)$$


for the predictor:

$$\begin{aligned} z_k &= H \hat{x}_k^- + v_k \\ S_k &= H P_k^- H^T + R_k \\ \hat{x}_k &= \hat{x}_k^- + K_k (z_k - H \hat{x}_k^-) \end{aligned} \quad (7)$$

The measurement update equation  $\hat{x}_k$  is the estimate reference current of  $i_d$  and  $i_q$ ,  $\hat{x}_k^-$  is the predicted state,  $z_k$  is the measurement of actual current,  $P_k$  is the estimate error covariance,  $R_k$  is the observation covariance matrix and  $K_k$  is the Kalman gain. In this representation, matrix  $P$  is the variance matrix of the error  $x_k - \hat{x}_k$  where the goal is to minimize this value. Here the Kalman gain calculation will be based on the conventional calculation defined in Eq. (8):

$$\begin{aligned} K_k &= P_k^- H^T S^{-1} \\ P_k &= (I - K_k H) P_k^- \end{aligned} \quad (8)$$

The process noise covariance matrix  $Q$  and observation noise covariance matrix  $R$  are tuned manually in order to achieve the optimal performance of the filter. **Figure 4** shows the cycle of KF.

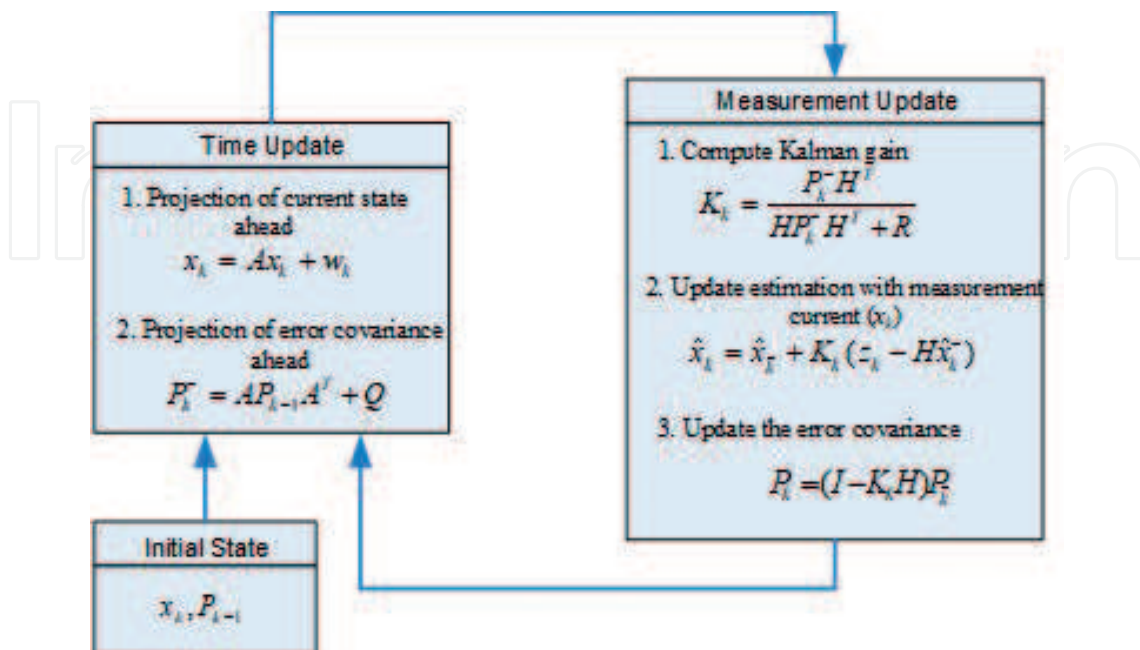

**Figure 4.** Cycle of discrete Kalman filter.

### 3. Simulation and experimental result


The proposed simulation and experimental results designed for the three-phase reference current generation employing KF estimator for three-phase shunt APF are presented. The work is simulated and implemented using Matlab Simulink and dSPACE.

#### 3.1. Non-linear load


The results for the APF before and after compensation are simulated using Matlab Simulink, while Fluke Power Quality Analyzer captures the results for the experimental. **Figure 5(a)** and **(b)** shows the supply current waveform before the compensation for simulation and experimental result; thus, the harmonic spectrum of both simulation and experimental is shown in **Figure 6**, respectively.

From the harmonic spectrum results, the total harmonic distortion (THD) can be determined by using the formula defined as.

$$\%THD = \frac{\sqrt{\sum_{h=2}^{\infty} I_h^2}}{I_f} \quad (9)$$

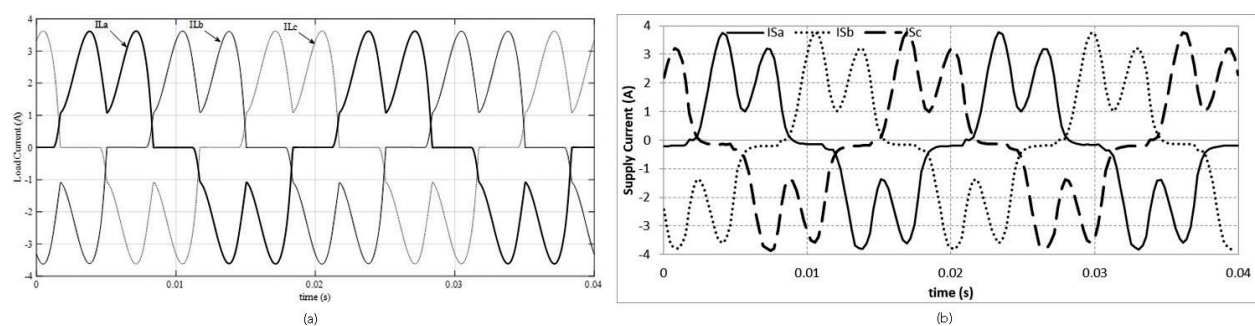

**Figure 5.** Simulation and experimental result without shunt APF (a) simulation and (b) Experiment.

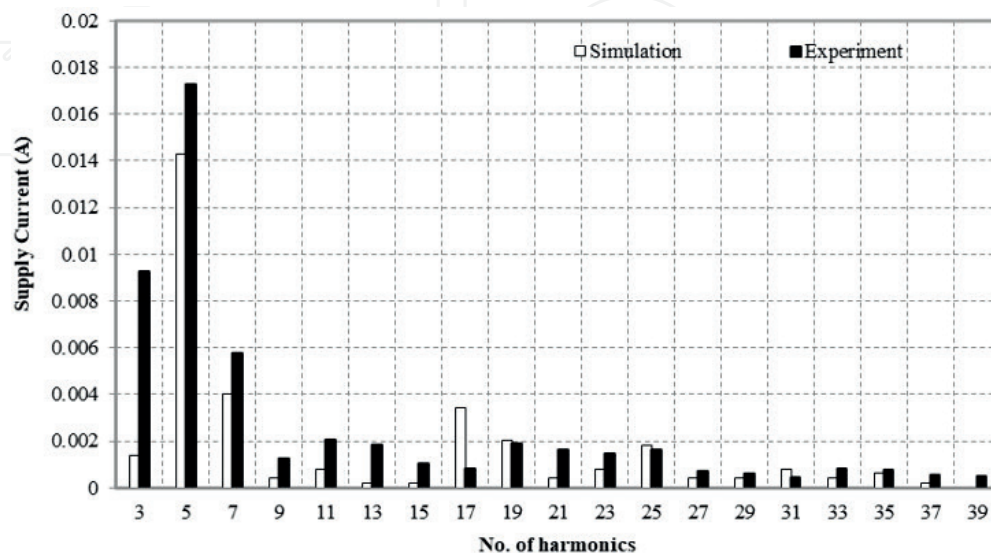

**Figure 6.** Harmonic spectrum before the compensation.

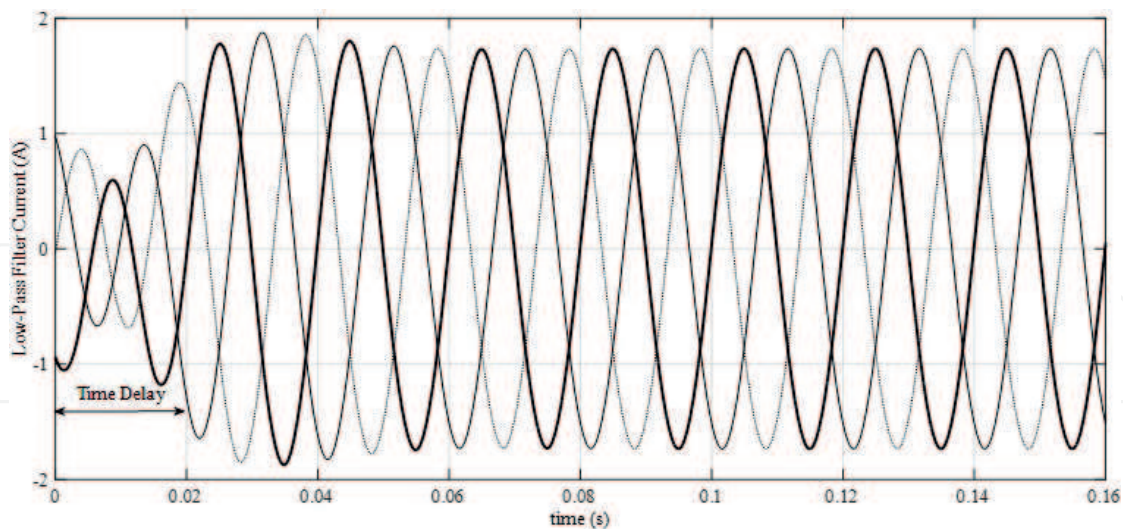


Figure 7. Simulation Butterworth low-pass filter.

where  $I_h$  is the harmonic component,  $I_f$  is the fundamental component, and  $n$  is the harmonic number: 2, 3, 4, etc.

Therefore, the THD of the line current obtained by the simulation is 56.14%, while the experimental obtains about 47.26%. There are slightly different between the simulation and experimental results because the simulation is simulated at an ideal condition.

### 3.2. Kalman filter estimator result versus low-pass filter

Commonly, a Butterworth low-pass filter (LPF) was applied to filter out the unwanted DC component for  $d$ - $q$  algorithm to ensure that the correct reference currents are generated in the system. Failure to obtain the correct reference current resolves reduction of the overall

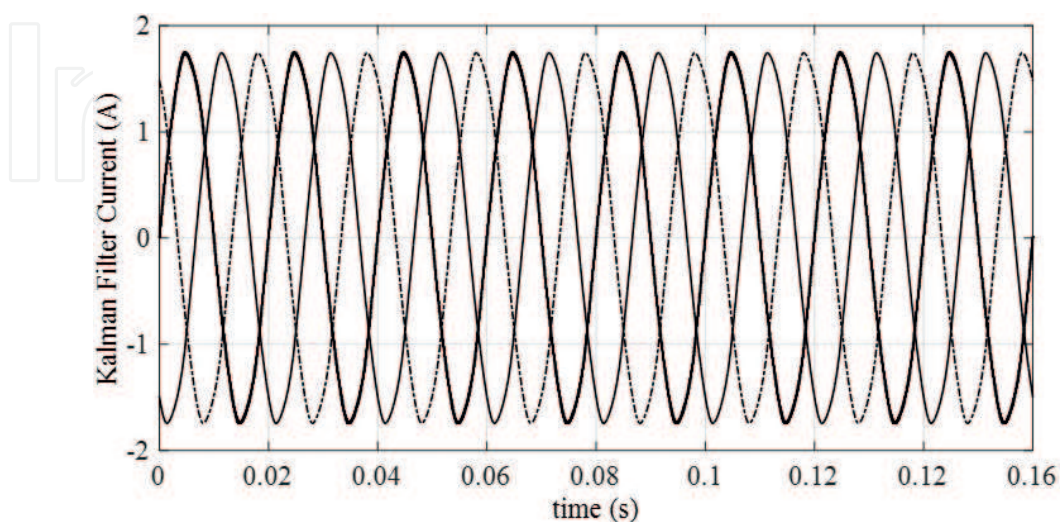


Figure 8. Simulation of Kalman filter.



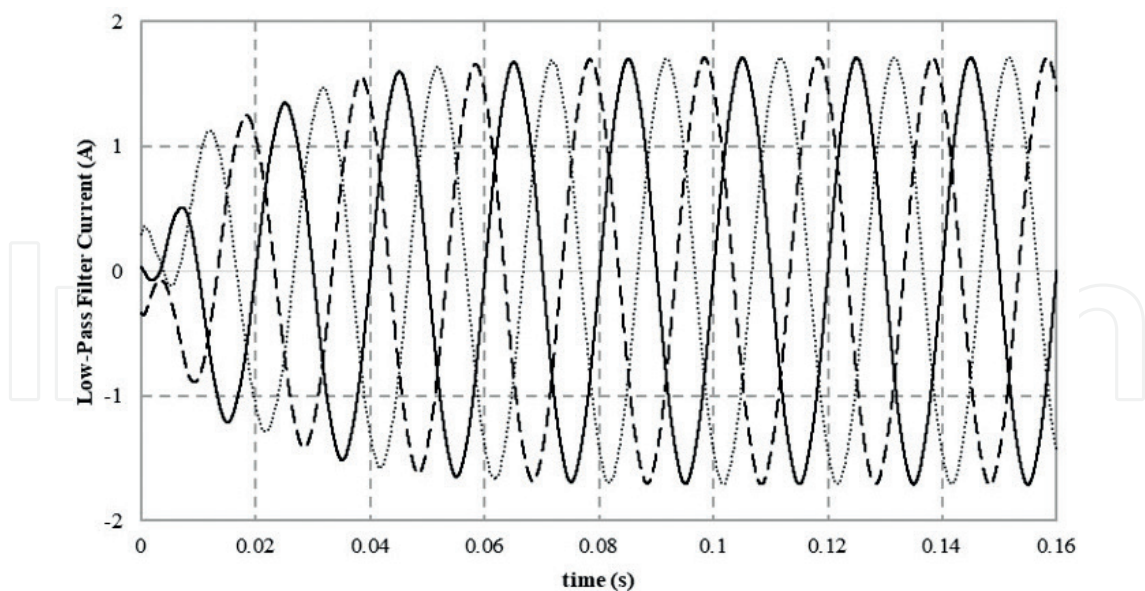


Figure 9. Experimental Butterworth low-pass filter.

performance of the active power filter (APF). But, time delay which contributes to the phase shift in harmonics and high transient current is the common effect when applying the LPF. **Figure 7** shows the shunt APF when applying Butterworth LPF. It is clearly shown that from the figure, the time delay is recorded at 0.02 s with 43.36% of the THD. On the other hand, there is no time delay when applying the shunt APF using KF estimator which is shown in **Figure 8**. Therefore, the THD produced by the KF estimator is 98% improvement compared to LPF. On the other hand, the experimental results for low-pass and KF are shown in **Figures 9** and **10**, respectively.

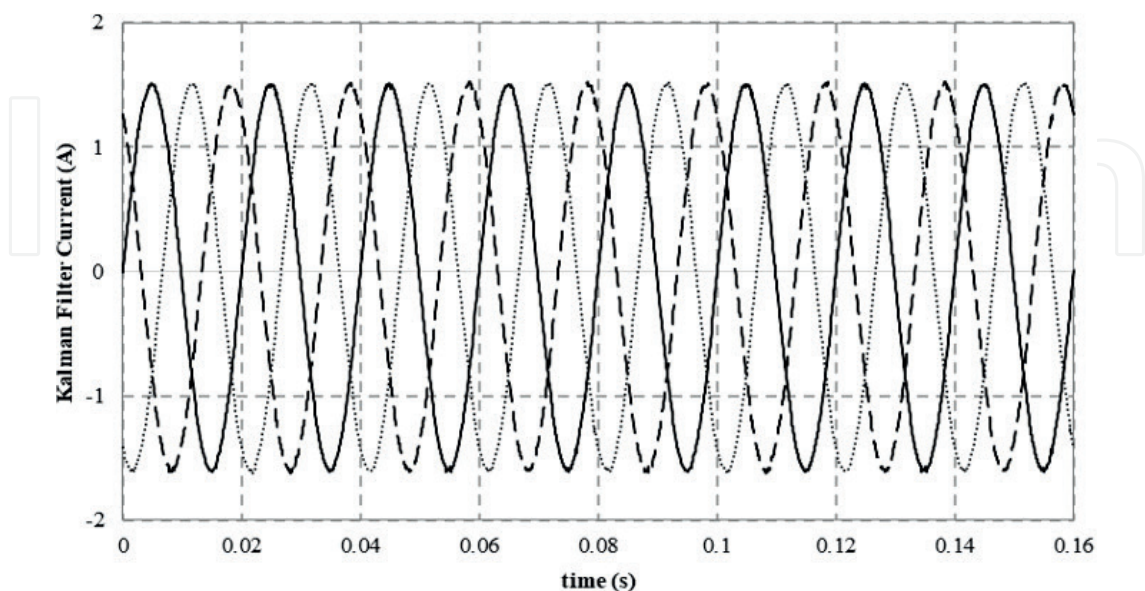


Figure 10. Experiment of Kalman filter.

### 3.3. Three-phase shunt active power filter


In this shunt active power filter feeding a non-linear load, the results between Butterworth LPF and KF estimator are compared between simulation and experimental, which are shown in **Figures 11** and **12**, respectively.

From the results obtained, it can be concluded that almost the same waveform was produced for both simulation and experimental approaches. Furthermore, the harmonic spectrum form the experimental is shown in **Figure 13**.


Both methods have demonstrated a harmonic reduction with almost identical fundamental current between simulation and experimental.

The THD results obtained show that the new technique shunt APF abides the regulation of IEEE 519–1992 standard. **Tables 1** and **2** show the THD after simulation and experimental results, respectively.

From the observation, the shunt APF using KF estimator technique produces about 0.1% better THD than LPF either in simulation or experimental.

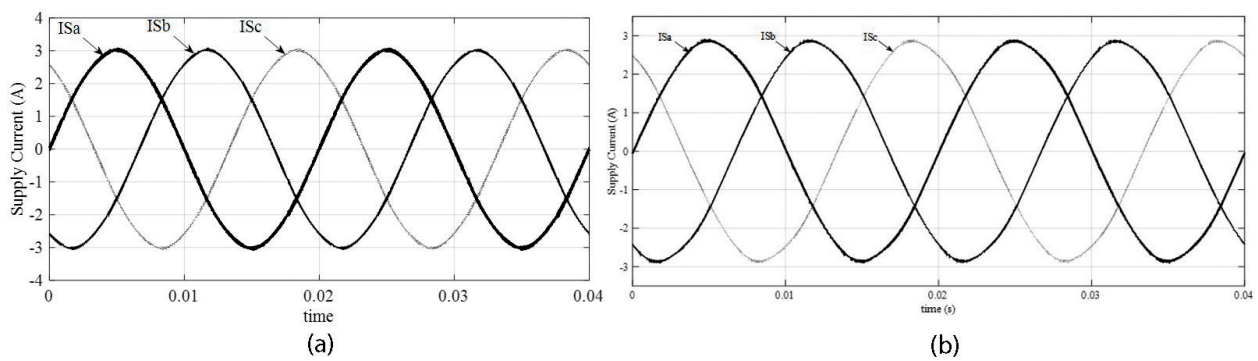

**Figure 11.** Simulation result for shunt APF (a) low-pass filter and (b) Kalman filter.

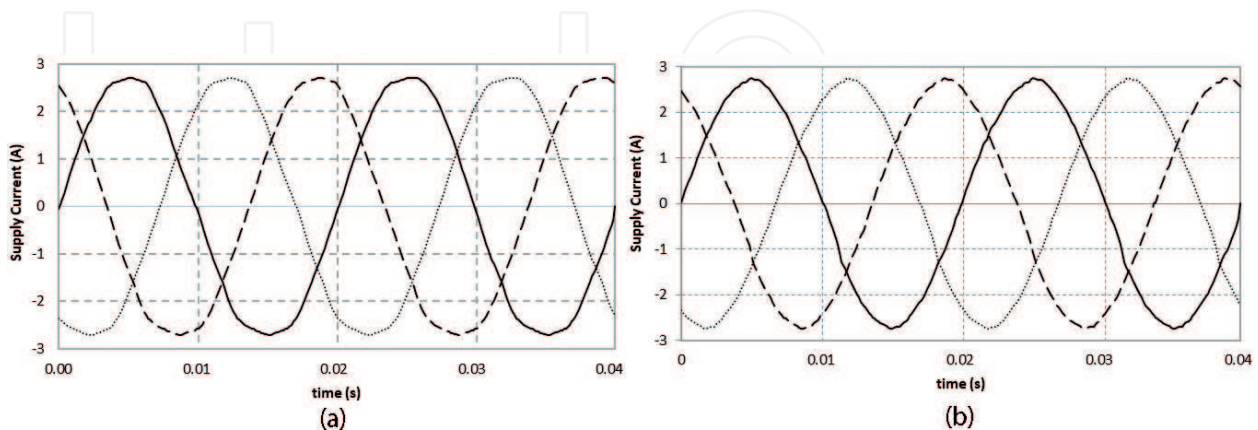

**Figure 12.** Experimental results for shunt APF: (a) low-pass filter and (b) Kalman filter.



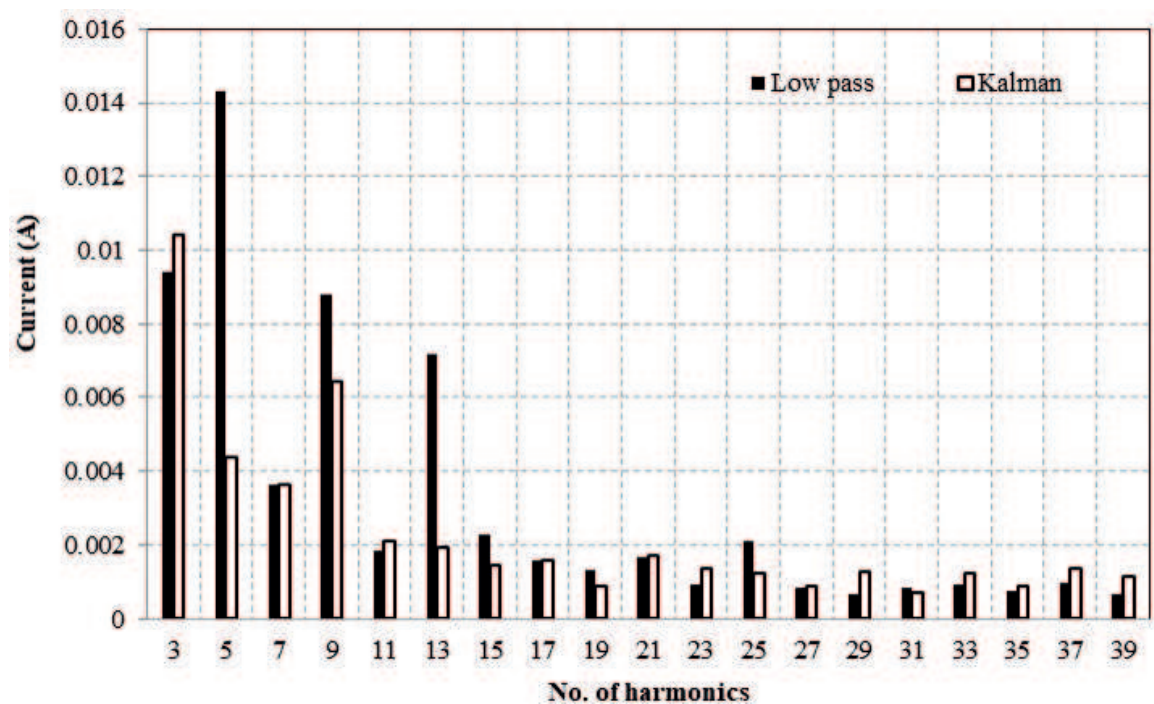


Figure 13. Harmonics spectrum.

Types of reference current generation	THD before (%)	THD after (%)
Low-pass filter	55.88	2.09
Kalman filter estimator		1.99

Table 1. Simulation results.

Types of reference current generation	THD before (%)	THD after (%)
Low-pass filter	47.27	2.30
Kalman filter estimator		2.18

Table 2. Experimental results.

3.4. Operation with three-phase induction motor speed drive

A 1.5 kW, 380 V variable speed induction motor (IM) drive is connected in parallel to the APF and the three-phase supply voltages. The motor is operated as a non-linear load and starts to accelerate from standstill at time,  $t = 0.06$  s, until it reached the required reference speed which is set at 1400 rpm. **Figures 14 and 15** show the supply current when the IM starts to accelerate without and with shunt APF, respectively. Fluke Power Quality Analyzer was used to measure

the THD at steady-state condition ( $t = 0.28$  s). THD obtained before applying shunt APF is 168.39%, whereas when applying the shunt APF using both KF and LFP, the THD reduced to 2.38 and 2.80%. Furthermore, the harmonic spectrum with or without shunt APF for both KF and LFP is shown in **Figures 16–18**, respectively. It can conclude that from the results, the shunt APF employing KF-based estimator produced lower THD than LFP for an induction motor drive application.

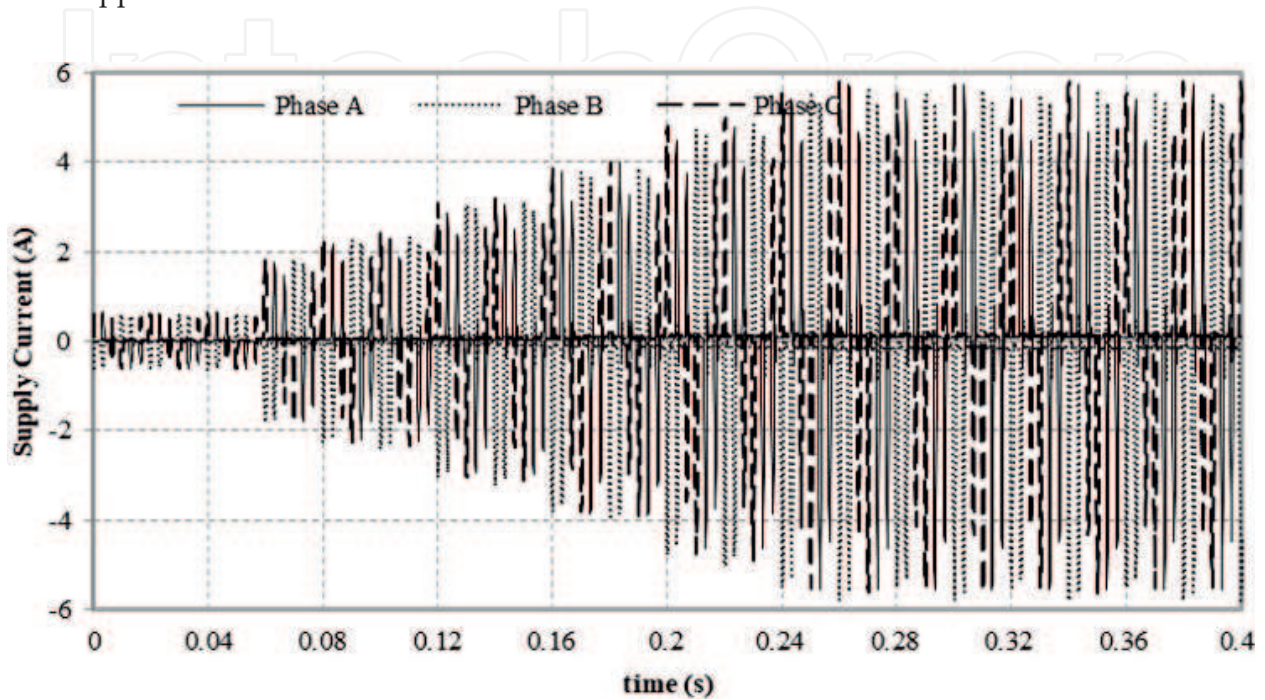


Figure 14. Supply current waveform without shunt APF.

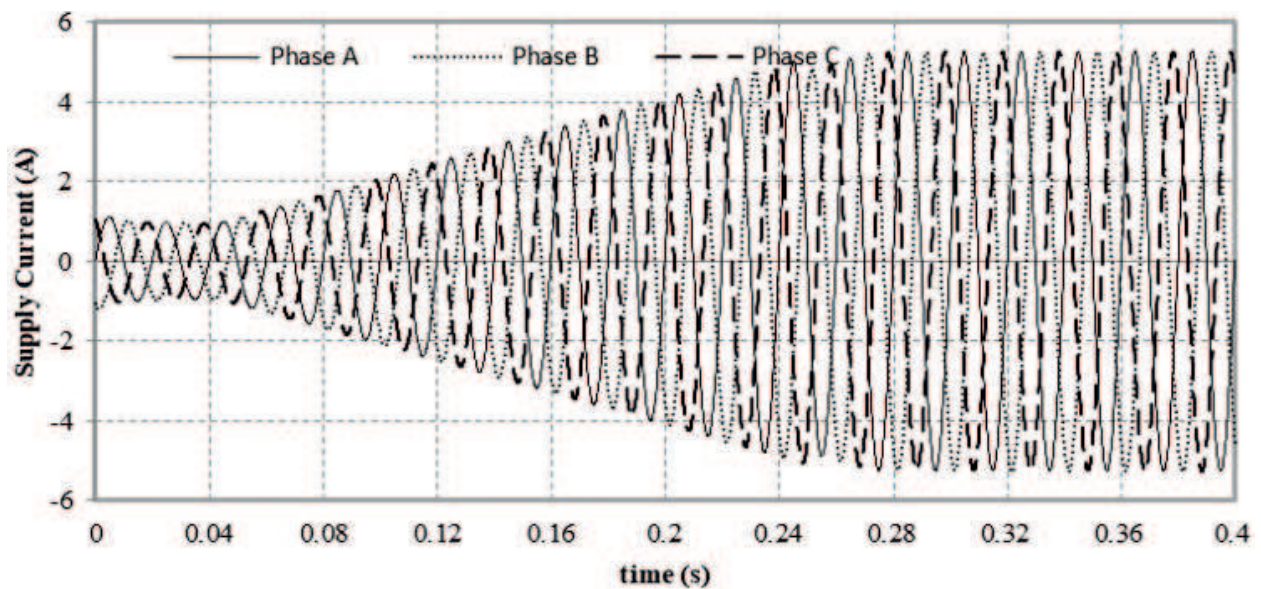


Figure 15. Supply current when applying shunt APF with Kalman filter estimator.



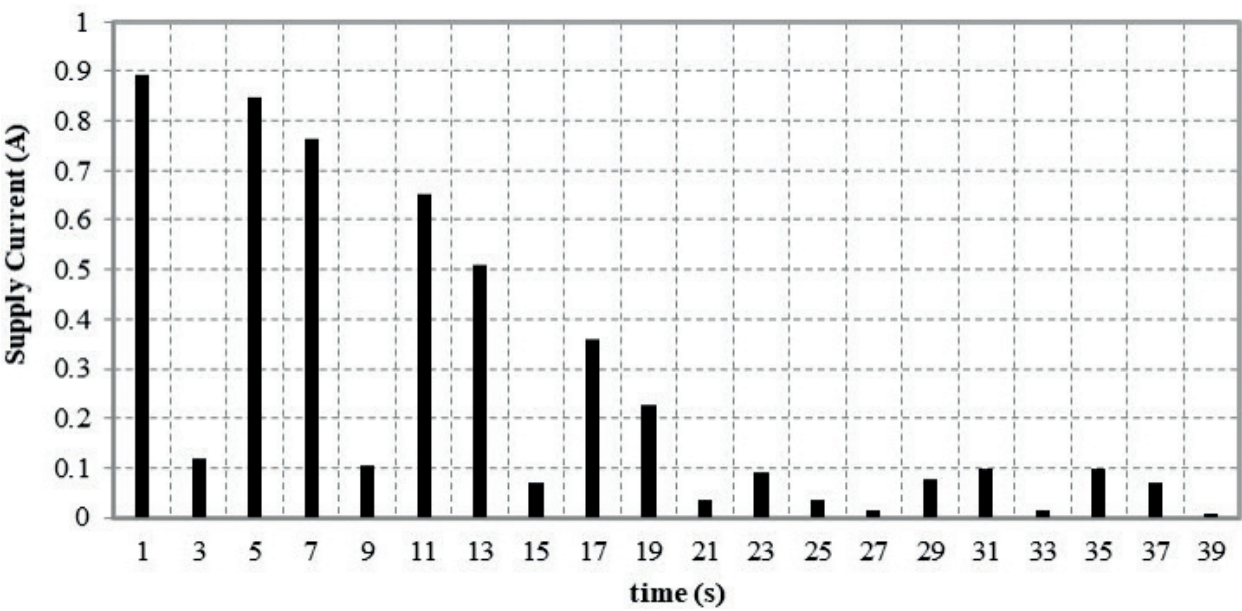


Figure 16. Harmonic spectrum without shunt APF.


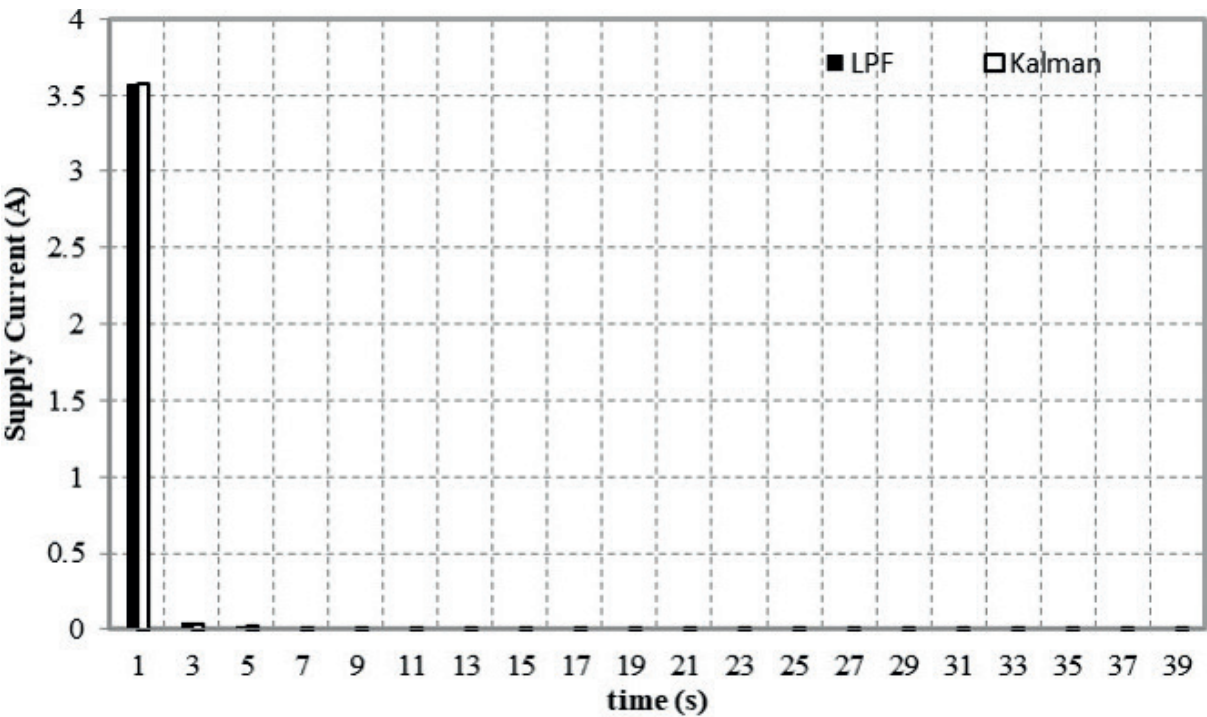


Figure 17. Harmonics spectrum after applying shunt APF.

The overall total harmonic distortion with or without shunt APF is shown tabulated in **Table 3**, which shows that the KF estimator produces lower THD than LPF for three-phase induction motor.

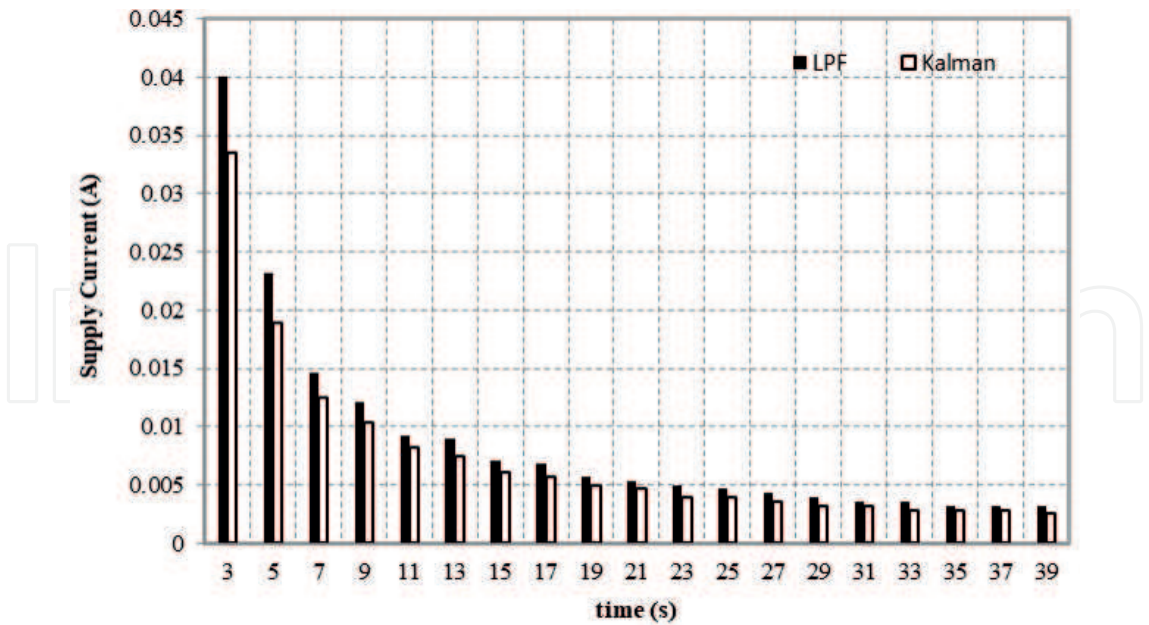

**Figure 18.** Harmonics spectrum without fundamental.

Reference current generation	THD before (%)	THD after (%)
Low-pass filter	168.39	2.80
Kalman filter estimator		2.38

**Table 3.** THD of supply current before and after applying shunt APF.

4. Conclusion

The new techniques of reference current generator by employing KF estimator for shunt APF technique have been presented. The results of the proposed technique in generating the three-phase reference current towards reducing the THD are established using simulation and experimental. For the three-phase rectifier connected with RC load, the performance of the proposed technique is comparable with those based on the LPF reference current generation. The THD of the source current from the experimental result after the compensation is 2.18% which is less than 5% of the harmonic limit imposed by the IEEE 519 standard. Furthermore, nearly 0.1% THD improvement was gained by the proposed techniques compared to LPF. Thus, the comparison of different reference current grid generations for shunt APF is also presented. The performance of KF estimator reference current generation was also studied for induction motor variable speed drive. In induction motor, almost 0.42% improvement of THD was gathered when applying KF estimator compared to LPF.

5. Future works

Although the proposed technique improved the overall performance of shunt APF, there is a room of improvement and suggestion for further research work such as:

1. The hysteresis band plays a significant influence to the THD reduction. With the lower hysteresis band, more accurate PWM generated, thereby improving the THD. In this thesis, the hysteresis band is set to  $\pm 0.08$  while in simulation at  $\pm 0.001$ . Therefore, in order to have faster and more accurate result, the combination of dSpace and FPGA can be implemented to reduce the computational time from the dSpace.
2. Further combination between shunt APF and passive filter (hybrid APF) can be used to improve the performance of the APF. Where the passive filter used to filter the higher order harmonic while shunt APF filter the lower order harmonic.
3. Apply the Kalman filter to the instantaneous real and reactive algorithm. Conventionally, the technique used  $p-q$  algorithm that combined with high-pass filter. However, Kalman filter can be used to replace it, and the performance of the system can be further investigated.

## Author details

Ahmad Shukri Bin Abu Hasim<sup>1\*</sup>, Syed Mohd Fairuz Bin Syed Mohd Dardin<sup>1</sup> and Zulkifilie Bin Ibrahim<sup>2</sup>

\*Address all correspondence to: [shukri@upnm.edu.my](mailto:shukri@upnm.edu.my)

1 Department of Electrical and Electronics Engineering, Faculty of Engineering, National Defence University of Malaysia, Kuala Lumpur, Malaysia

2 Faculty of Electrical Engineering, Universiti Teknikal Malaysia Melaka, Melaka, Malaysia

## References

- [1] Duffey CK, Stratford RP. Update of harmonic standard IEEE-519-IEEE recommended practices and requirements for harmonic control in electric power systems. In: Conference Record of the IEEE Industry Applications Society Annual Meeting. 1989;2:1618-1624
- [2] Shuter TC, Vollkommer HT, Kirkpatrick TL. Survey of harmonic levels on the American electric power distribution system. IEEE Transactions on Power Delivery. 1989;4:2204-2213
- [3] Subjak JS Jr, McQuilkin JS. Harmonics-causes, effects, measurements, and analysis: An update. IEEE Transactions on Industry Applications. 1990;26:1034-1042
- [4] Beides HM, Heydt GT. Dynamic state estimation of power system harmonics using Kalman filter methodology. IEEE Transactions on Power Delivery. 1991;6:1663-1670
- [5] Gruzs TM. Uncertainties in compliance with harmonic current distortion limits in electric power systems. IEEE Transactions on Industry Applications. 1991;27:680-685
- [6] Emanuel AE, Orr JA, Cyganski D, Gulachenski EM. A survey of harmonic voltages and currents at the customer's bus. IEEE Transactions on Power Delivery. 1993;8:411-421



- [7] Henderson RD, Rose PJ. Harmonics: The effects on power quality and transformers. *IEEE Transactions on Industry Applications*. 1994;**30**:528-532
- [8] Mansoor A, Grady WM, Staats PT, Thallam RS, Doyle MT, Samotyj MJ. Predicting the net harmonic currents produced by large numbers of distributed single-phase computer loads. *IEEE Transactions on Power Delivery*. 1995;**10**:2001-2006
- [9] Clark SL, Famouri P, Cooley WL. Elimination of supply harmonics. *IEEE Industry Applications Magazine*. 1997;**3**:62-67
- [10] Kazerani M, Ziogas PD, Joos G. A novel active current waveshaping technique for solid-state input power factor conditioners. *IEEE Transactions on Industrial Electronics*. 1991;**38**:72-78
- [11] Enjeti P, Shireen W, Pitel I. Analysis and design of an active power filter to cancel harmonic currents in low voltage electric power distribution systems. In: *Proceedings of the 1992 International Conference on Industrial Electronics, Control, Instrumentation, and Automation*. 1992;**1**:368-373
- [12] Duke RM, Round SD. The steady-state performance of a controlled current active filter. *IEEE Transactions on Power Electronics*. 1993;**8**:140-146
- [13] Round SD, Mohan N. Comparison of frequency and time domain neural network controllers for an active power filter. In: *Proceedings of the IECON '93, International Conference on Industrial Electronics, Control, and Instrumentation*; 1993. 1993;**2**:1099-1104
- [14] Jou HL, Wu JC, Chu HY. New single-phase active power filter. *IEE Proceedings—Electric Power Applications*. 1994;**141**:129-134
- [15] Nastran J, Cajhen R, Seliger M, Jereb P. Active power filter for nonlinear AC loads. *IEEE Transactions on Power Electronics*. 1994;**9**:92-96
- [16] Jae-Ho C, Ga-Woo P, Dewan SB. Standby power supply with active power filter ability using digital controller. In: *Applied Power Electronics Conference and Exposition, 1995. APEC '95. Conference Proceedings 1995, Tenth Annual*. 1995;**2**:783-789
- [17] Torrey DA, Al-Zamel AMAM. Single-phase active power filters for multiple nonlinear loads. *IEEE Transactions on Power Electronics*. 1995;**10**:263-272
- [18] Kim YJ, Kim JS, Kim YS. Single-phase active power filter based on rotating reference frame method. In: *Proceedings of the Eighth International Conference on Electrical Machines and Systems, 2005. ICEMS 2005*. 2005. pp. 1428-1431
- [19] Khan MM, Feng JF, Chen C, Zhiming W. Single-phase dynamically decoupled active power filter for system-integrated application. *IEEE Proceedings—Electric Power Applications*. 2006;**153**:625-631
- [20] Rudnick H, Dixon J, Moran L. Delivering clean and pure power. *IEEE Power and Energy Magazine*. 2003;**1**:32-40

- [21] Rahim NA, Mekhilef S, Zahrul I. A single-phase active power filter for harmonic compensation. In: IEEE International Conference on Industrial Technology, 2005. ICIT 2005. 2005. pp. 1075-1079
- [22] Wang X, Liu J, Yuan C, Wang Z. A comparative study on voltage-source control and current-source control of series active power filter. In: Applied Power Electronics Conference and Exposition, 2006. APEC '06. Twenty-First Annual IEEE. 2006. 6 pp
- [23] Chang GW, Chen SK, Chin YC, Chen WC. An a-b-c reference frame-based compensation strategy for series active power filter control. In: 2006 1ST IEEE Conference on Industrial Electronics and Applications. 2006. pp. 1-4
- [24] Hurng-Liahng J, Jinn-Chang W, Yao-Jen C, Ya-Tsung F. A novel active power filter for harmonic suppression. IEEE Transactions on Power Delivery. 2005;**20**:1507-1513
- [25] Moran LT, Mahomar JJ, Dixon JR. Careful connection. IEEE Industry Applications Magazine. 2004;**10**:43-50
- [26] El-Habrouk M, Darwish MK, Mehta P. Active power filters: A review. IEE Proceedings—Electric Power Applications. 2000;**147**:403-413
- [27] Golwala H, Chudamani R. Comparative study of switching signal generation techniques for three phase four wire shunt active power filter. In: Electric Machines & Drives Conference (IEMDC), 2011 IEEE International. 2011. pp. 1409-1414
- [28] Zeng FP, Tan GH, Wang JZ, Ji YC. Novel single-phase five-level voltage-source inverter for the shunt active power filter. IET Power Electronics. 2010;**3**:480-489
- [29] Rahmani S, Mendalek N, Al-Haddad K. Experimental design of a nonlinear control technique for three-phase shunt active power filter. IEEE Transactions on Industrial Electronics. 2010;**57**:3364-3375
- [30] Golwala H, Chudamani R. Simulation of three-phase four-wire shunt active power filter using novel switching technique. In: 2010 Joint International Conference on Power Electronics, Drives and Energy Systems (PEDES) & 2010 Power India. 2010. pp. 1-7
- [31] Abdalla II, Rao KSR, Perumal N. Harmonics mitigation and power factor correction with a modern three-phase four-leg shunt active power filter. In: 2010 IEEE International Conference on Power and Energy (PECon). 2010. pp. 156-161
- [32] Vodyakho O, Mi CC. Three-level inverter-based shunt active power filter in three-phase three-wire and four-wire systems. IEEE Transactions on Power Electronics. 2009;**24**:1350-1363
- [33] Vodyakho O, Kim T, Kwak S, Edrington CS. Comparison of the space vector current controls for shunt active power filters. IET Power Electronics. 2009;**2**:653-664
- [34] Vodyakho O, Kim T. Shunt active filter based on three-level inverter for three-phase four-wire systems. IET Power Electronics. 2009;**2**:216-226

- [35] Uyyuru KR, Mishra MK, Ghosh A. An optimization-based algorithm for shunt active filter under distorted supply voltages. *IEEE Transactions on Power Electronics*. 2009;**24**:1223-1232
- [36] Singh B, Solanki J. An implementation of an adaptive control algorithm for a three-phase shunt active filter. *IEEE Transactions on Industrial Electronics*. 2009;**56**:2811-2820
- [37] Rahmani S, Hamadi A, Mendalek N, Al-Haddad K. A new control technique for three-phase shunt hybrid power filter. *IEEE Transactions on Industrial Electronics*. 2009;**56**:2904-2915
- [38] Peng X, Venayagamoorthy GK, Corzine KA. Seven-level shunt active power filter for high-power drive systems. *IEEE Transactions on Power Electronics*. 2009;**24**:6-13
- [39] Akagi H. The state-of-the-art of active filters for power conditioning. In: 2005 European Conference on Power Electronics and Applications. 2005. pp. 15
- [40] Akagi H. Active harmonic filters. *Proceedings of the IEEE*. 2005;**93**:2128-2141
- [41] Pini SH, Barbi I. A single-phase high-power-factor rectifier, based on a two-quadrant shunt active filter. *IEEE Transactions on Power Electronics*. 2011;**26**:3131-3143
- [42] Karuppanan P, Mahapatra K. PLL with PI, PID and fuzzy logic controllers based shunt active power line conditioners. In: 2010 Joint International Conference on Power Electronics, Drives and Energy Systems (PEDES) & 2010 Power India. 2010. pp. 1-6
- [43] Singh B, Verma V, Chandra A, Al-Haddad K. Hybrid filters for power quality improvement. *IEE Proceedings—Generation, Transmission and Distribution*. 2005;**152**:365-378
- [44] Zhao W, Luo A, Shen ZJ, Wu C. injection-type hybrid active power filter in high-power grid with background harmonic voltage. *IET Power Electronics*. 2011;**4**:63-71
- [45] A. Varschavsky, J. Dixon, M. Rotella, Moran L. Cascaded nine-level inverter for hybrid-series active power filter, using industrial controller, *IEEE Transactions on Industrial Electronics*; 2010;**57**:2761-2767
- [46] Salmeron P, Litran SP. Improvement of the electric power quality using series active and shunt passive filters. *IEEE Transactions on Power Delivery*. 2010;**25**:1058-1067
- [47] Luo A, Shuai Z, Zhu W, Shen ZJ, Tu C. Design and application of a hybrid active power filter with injection circuit. *IET Power Electronics*. 2010;**3**:54-64
- [48] Litran SP, Salmeron P, Vazquez JR, Herrera RS, Perez A. Control strategy for hybrid power filter to compensate unbalanced and non-linear, three-phase loads. In: 13th European Conference on Power Electronics and Applications, 2009. EPE '09. 2009. pp. 1-10
- [49] An L, Ci T, Zhi Kang S, Wei Z, Fei R, Ke Z. A novel three-phase hybrid active power filter with a series resonance circuit tuned at the fundamental frequency. *IEEE Transactions on Industrial Electronics*. 2009;**56**:2431-2440

- [50] Pal Y, Swarup A, Singh B. A review of compensating type custom power devices for power quality improvement. In: Joint International Conference on Power System Technology and IEEE Power India Conference, 2008. POWERCON 2008. 2008. pp. 1-8
- [51] Kazemi A, Sarlak M, Barkhordary M. An adaptive noise canceling method for single-phase unified power quality conditioner. In: 2006 1ST IEEE Conference on Industrial Electronics and Applications. 2006. pp. 1-6
- [52] Herrera RS, Salmeron P, Vazquez JR, Litran SP, Perez A. GENERALIZED instantaneous reactive power theory in poly-phase power systems. In: 13th European Conference on Power Electronics and Applications, 2009. EPE '09. 2009. pp. 1-10
- [53] Kelesidis K, Adamidis G, Tsengenes G. Investigation of a control scheme based on modified p-q theory for single phase single stage grid connected PV system. In: 2011 International Conference on Clean Electrical Power (ICCEP). 2011. pp. 535-540
- [54] Mulla MA, Rajagopalan C, Chowdhury A. Hardware implementation of series hybrid active power filter using a novel control strategy based on generalised instantaneous power theory. IET Power Electronics. 2013;6:592-600
- [55] Esfandiari A, Parniani M, Mokhtari H. A new control strategy of shunt active filters for power quality improvement of highly and randomly varying loads. In: 2004 IEEE International Symposium on Industrial Electronics. 2004;2:1297-1302
- [56] Sawant RR, Chandorkar MC. Methods for multi-functional converter control in three-phase four-wire systems. IET Power Electronics. 2009;2:52-66
- [57] Salmeron P, Herrera RS, Vazquez JR. Mapping matrices against vectorial frame in the instantaneous reactive power compensation. IET Electric Power Applications. 2007;1:727-736
- [58] Bhattacharya A, Chakraborty C, Bhattacharya S. Parallel-connected shunt hybrid active power filters operating at different switching frequencies for improved performance. IEEE Transactions on Industrial Electronics. 2012;59:4007-4019
- [59] Suresh Y, Panda AK, Suresh M. Real-time implementation of adaptive fuzzy hysteresis-band current control technique for shunt active power filter. IET Power Electronics. 2012;5:1188-1195
- [60] Quoc-Nam T, Hong-Hee L. An advanced current control strategy for three-phase shunt active power filters. IEEE Transactions on Industrial Electronics. 2013;60:5400-5410
- [61] Asiminoaei L, Blaabjerg F, Hansen S. Detection is key—harmonic detection methods for active power filter applications. IEEE Industry Applications Magazine. 2007;13:22-33
- [62] Jain SK, Singh SN. Harmonics estimation in emerging power system: Key issues and challenges. Electric Power Systems Research. 2011;81:1754-1766
- [63] Moreno VM, Lopez AP, Garcias RID. Reference current estimation under distorted line voltage for control of shunt active power filters. IEEE Transactions on Power Electronics. 2004;19:988-994

- [64] Petit JF, Robles G, Amaris H. Predictive algorithm for harmonic mitigation in non-linear loads based on active filters. In: Power Tech, 2005 IEEE Russia. 2005. pp. 1-6
- [65] Rosendo JA, Bachiller A, Gomez A. Application of self-tuned Kalman filters to control of active power filters. In: Power Tech, 2007 IEEE Lausanne. 2007. pp. 1262-1265
- [66] Cardoso R, de Camargo RF, Pinheiro H, Grundling HA. Kalman filter based synchronisation methods. *IET Generation, Transmission & Distribution*. 2008;**2**:542-555
- [67] Panigrahi R, Panda PC, Subudhi BD. Comparison of performances of hysteresis and dead beat controllers in active power filtering. In: 2012 IEEE Third International Conference on Sustainable Energy Technologies (ICSET). 2012. pp. 287-292
- [68] Regulski P, Terzija V. Estimation of frequency and fundamental power components using an unscented Kalman filter. *IEEE Transactions on Instrumentation and Measurement*. 2012;**61**:952-962
- [69] Kanieski JM, Cardoso R, Pinheiro H, Grundling HA. Kalman filter-based control system for power quality conditioning devices. *IEEE Transactions on Industrial Electronics*. 2013;**60**:5214-5227